

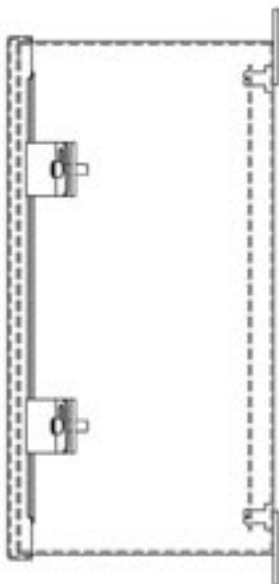
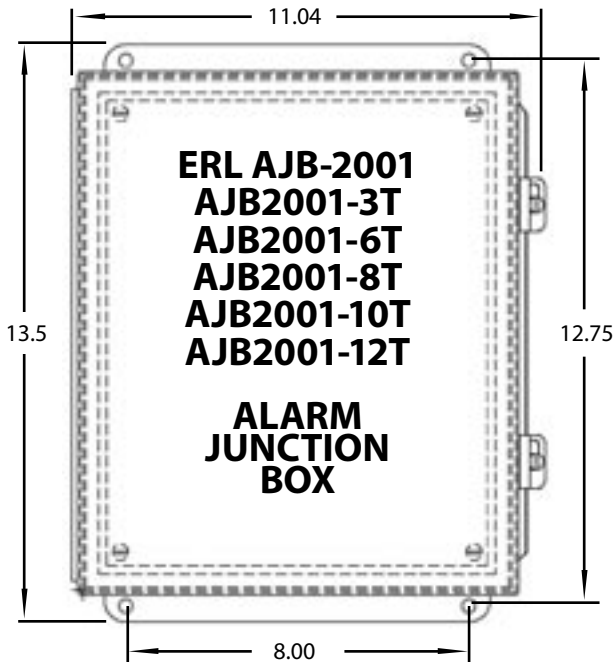


HIGH LEVEL/OVERFILL ALARM SENSOR WIRING INTERCONNECT BOX

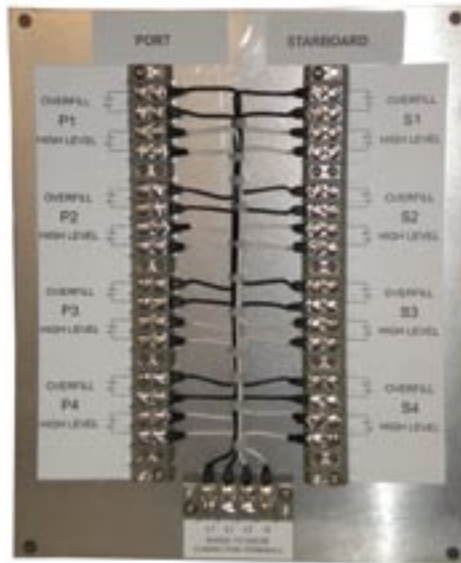


STAINLESS STEEL CONSTRUCTION

NEMA 4R

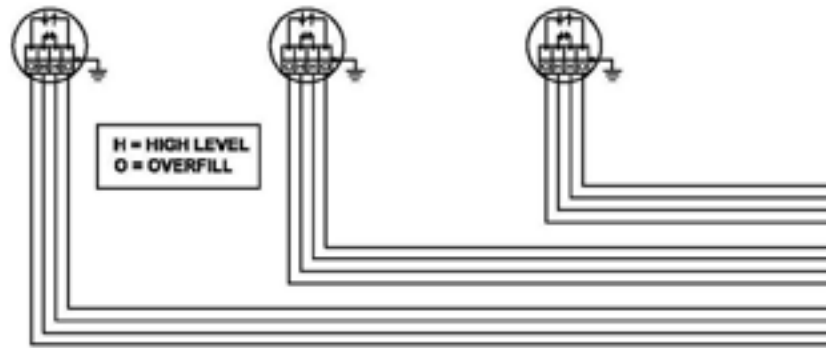

THE HIGH LEVEL/OVERFILL SENSORS ARE LOCATED IN A CLASS 1, GROUP D, HAZARDOUS LOCATION. THESE N/C CONTACTS ARE CONNECTED IN SERIES. INSTALLATION PRACTICES PER 46 CFR PART 111.105 FOR HAZARDOUS LOCATIONS MUST BE FOLLOWED AS WELL AS API 1125. RECOMMENDED WIRE IS TPS16TIB-2 OR EQUAL; 4-CONDUCTOR, 16 GAUGE, BRONZE ARMOR, FOIL SHIELD WITH 20 GAUGE GROUND WIRE OR EQUAL. FTNSIA 16 GAUGE, 4 CONDUCTOR CABLE WITH COPPER SHIELD AND ALUMINUM ARMOR. CONNECT GROUND WIRE TO HULL.

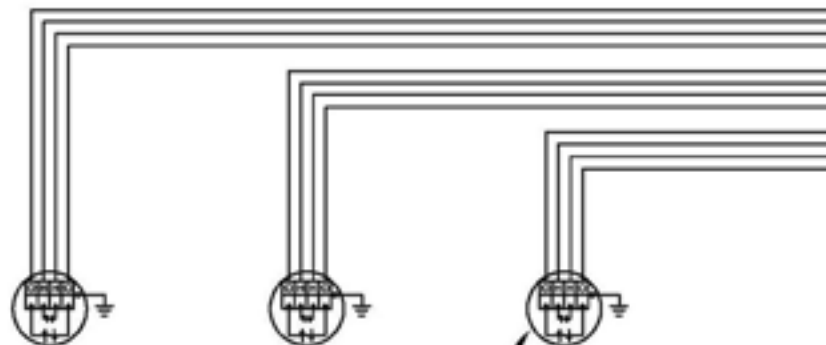

ERL Liquid Level Sensor, High Level & Overfill (1 per compartment)

